

This document must be retained for future reference.

It is the responsibility of the person installing the electrical equipment to ensure that the installation meets the requirements of the IET wiring regulations and is therefore 'fit for purpose'. Factors such as correct selection of components, cable sizing, protective devices and Earth bonding are all critical and should be checked prior to full testing and power-up. Any other regulations applicable to the equipment being installed such as the Machinery Directive and current health and safety legislation must also be adhered to.



All connections (including factory made) must be checked for the correct tightness prior to commissioning of the electrical installation. All connections should also be inspected periodically to ensure correct tightness.

DO NOT USE POWER TOOLS ON THESE PRODUCTS



## 125A Switched Interlocked Socket

- Spring-return lid with twist-lock ring
- IP67 Rated
- 2x Cable entries (Top): 1x M40 + 1x M50
- Captive screws included
- Padlockable in the OFF position
- Compliant with BS EN IEC 60309-4

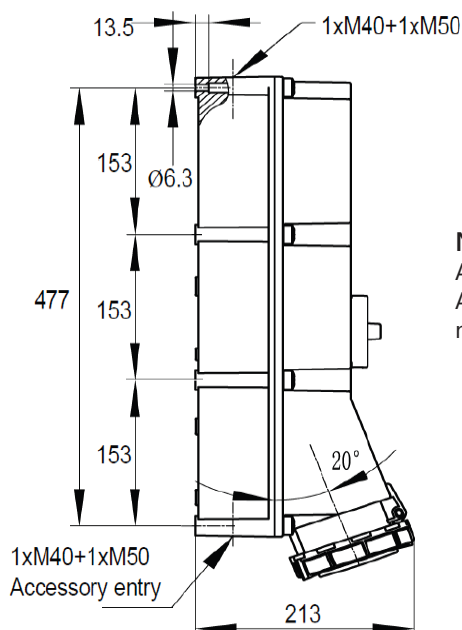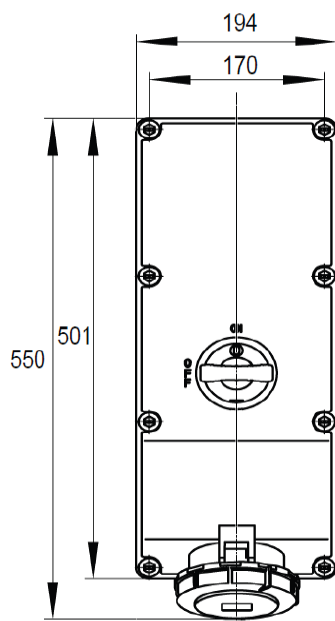

**Notes:**  
All dimensions in mm.  
All dimensions represent the part numbers shown in this data sheet.

Part Number	Amps (A)	Colour & Voltage	Poles	Protection Degree	Terminal Capacity	Recommended Terminal Torque
SISW1253P	125A	Blue 230 V	2P + E	IP67	50mm <sup>2</sup>	3Nm
SISW1254N		Red 415 V	3P + E			
SISW1255N		Red 415 V	3P + N + E			